


PROV	230V	NAVRH	KRIVANKA	13.7.2015
REV	2	KONTROLA	KRIVANKA	18.7.2015
ZMĚNA	04.06.18	SCHVALENI	KRIVANKA	23.7.2015



Power supply


ARCHON5	strana : 1
AR1000	listů : 4

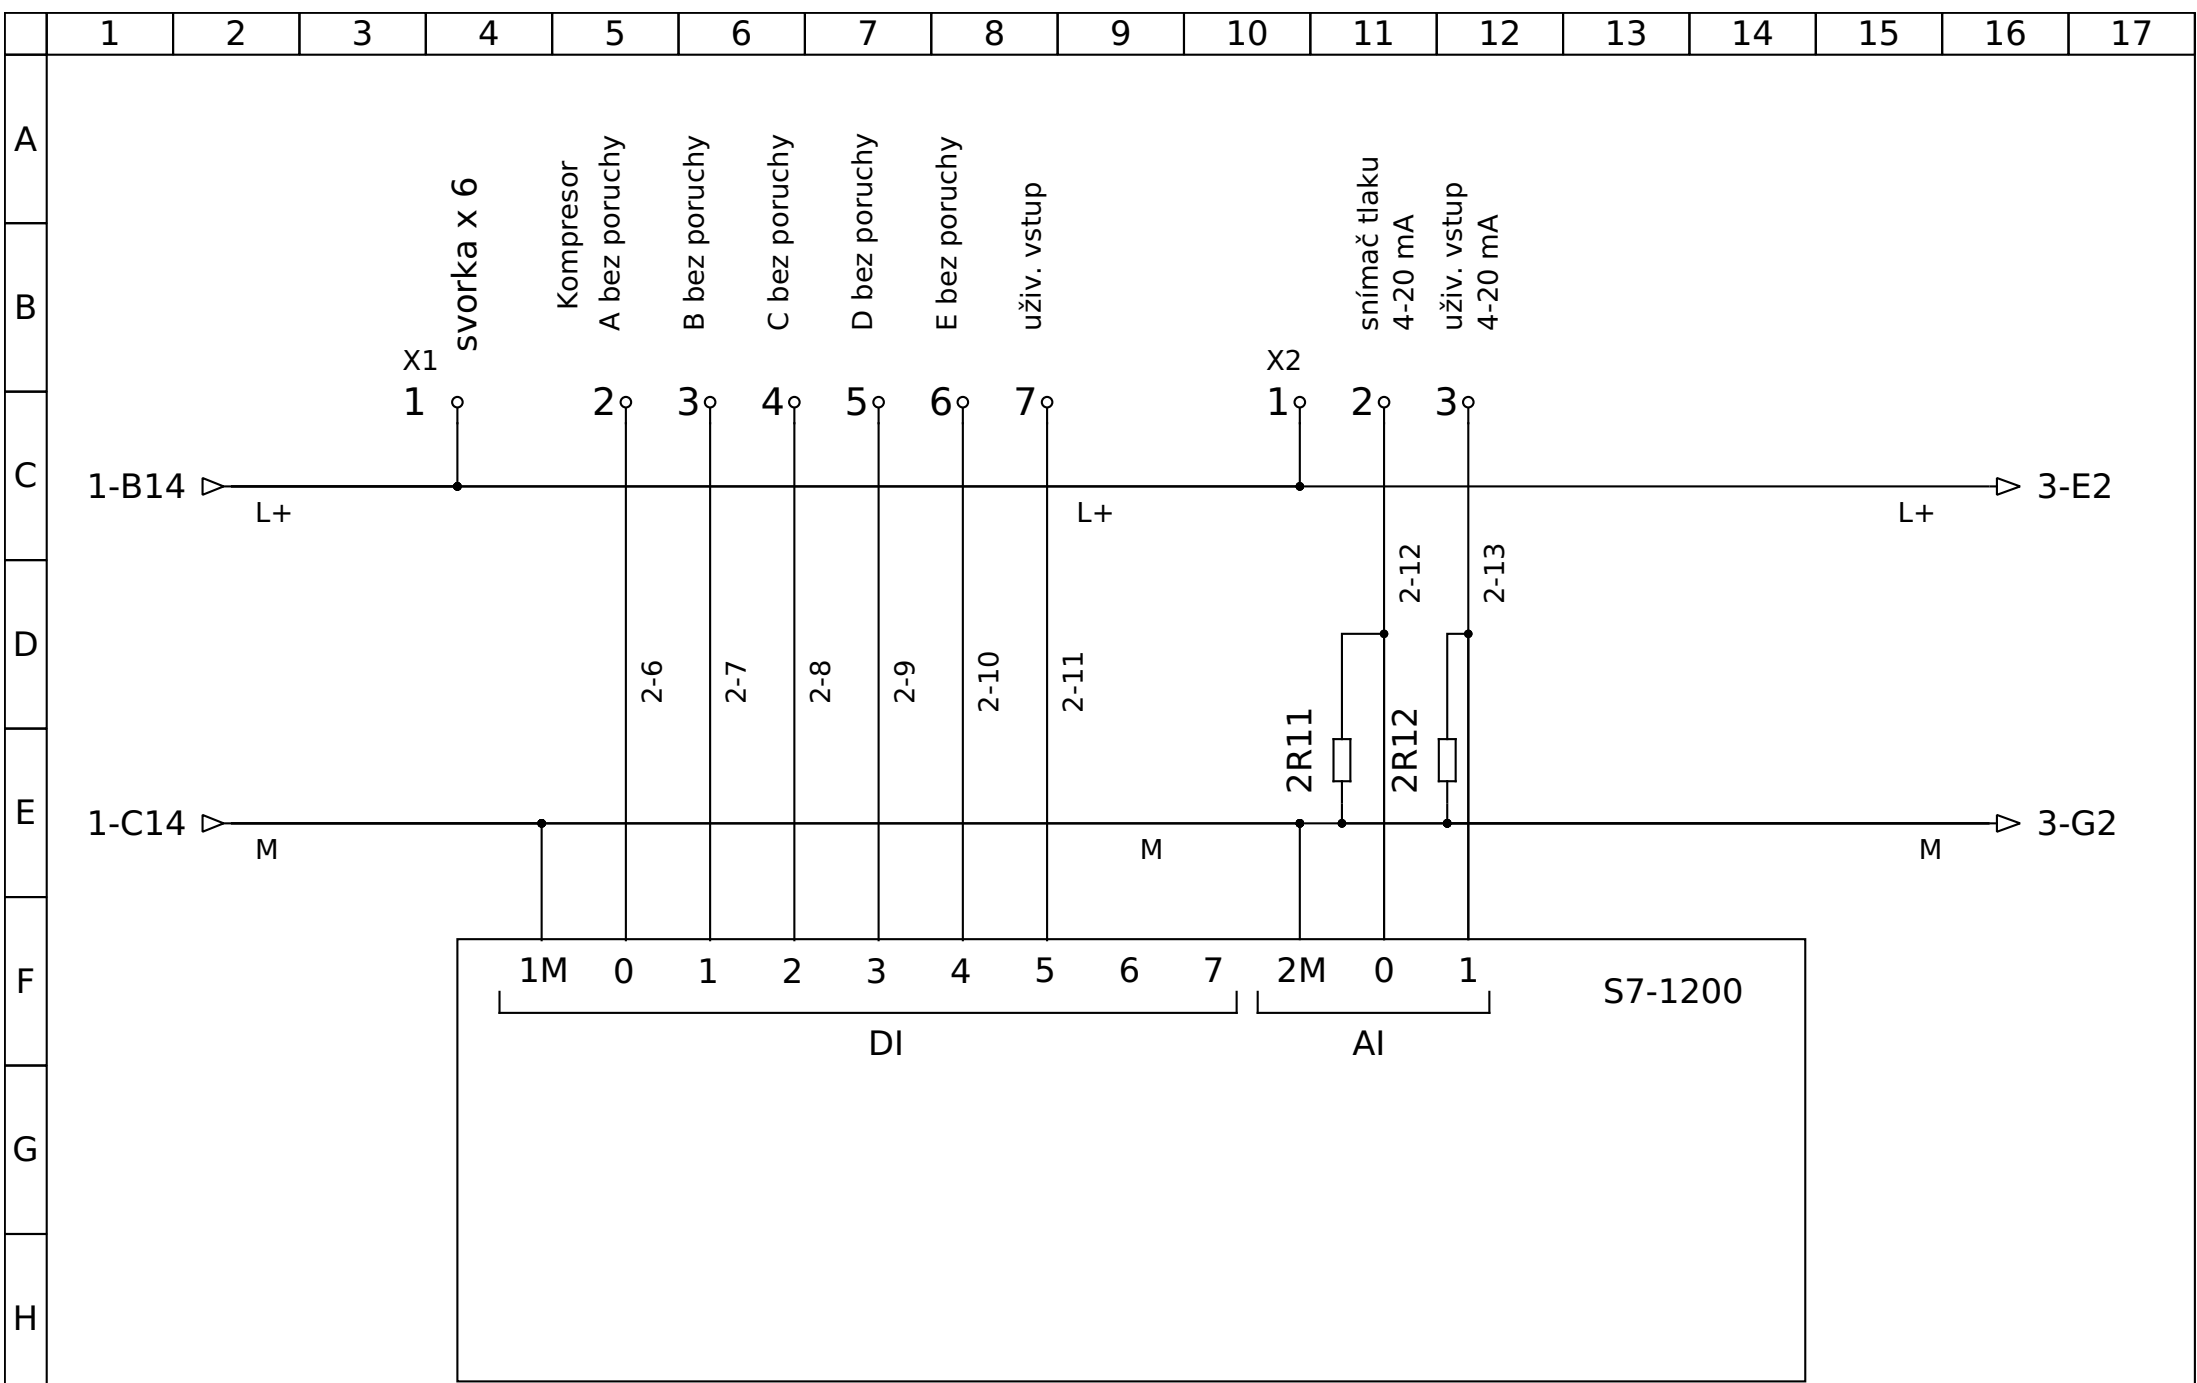

PROV	230v	NAVRH	KRIVANKA	13.7.2015
REV	2	KONTROLA	KRIVANKA	18.7.2015
ZMĚNA	04.06.18	SCHVALENÍ	KRIVANKA	23.7.2015




Digital/analog inputs

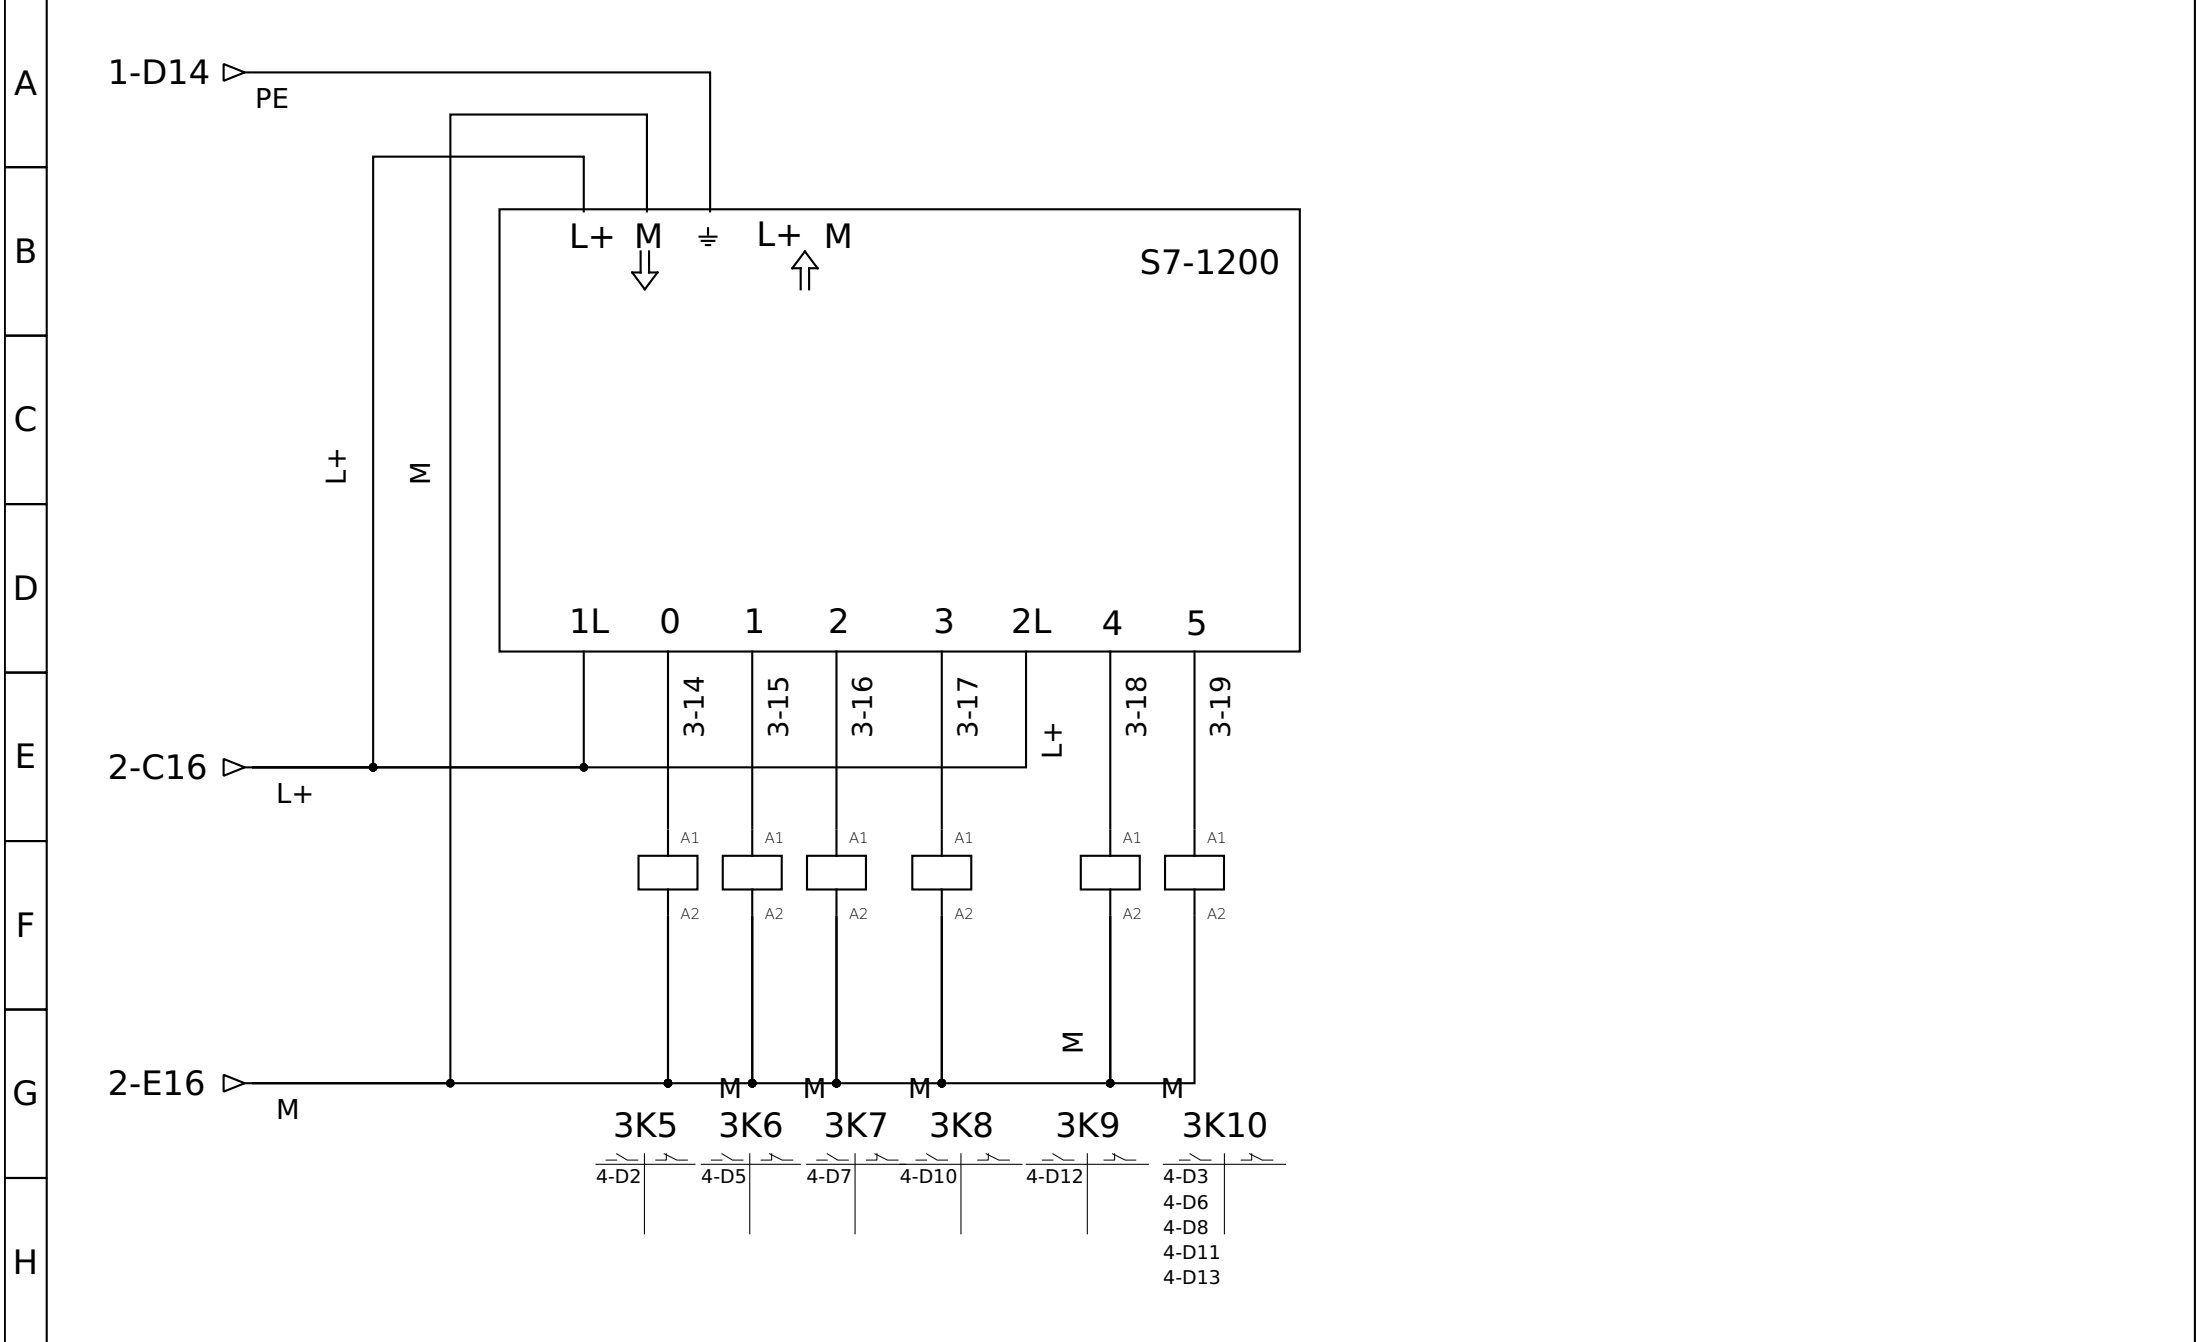

PROV	230V	NAVRH	KRIVANKA	13.7.2015
REV	2	KONTROLA	KRIVANKA	18.7.2015
ZMĚNA	04.06.18	SCHVALENI	KRIVANKA	23.7.2015



Controller DQ

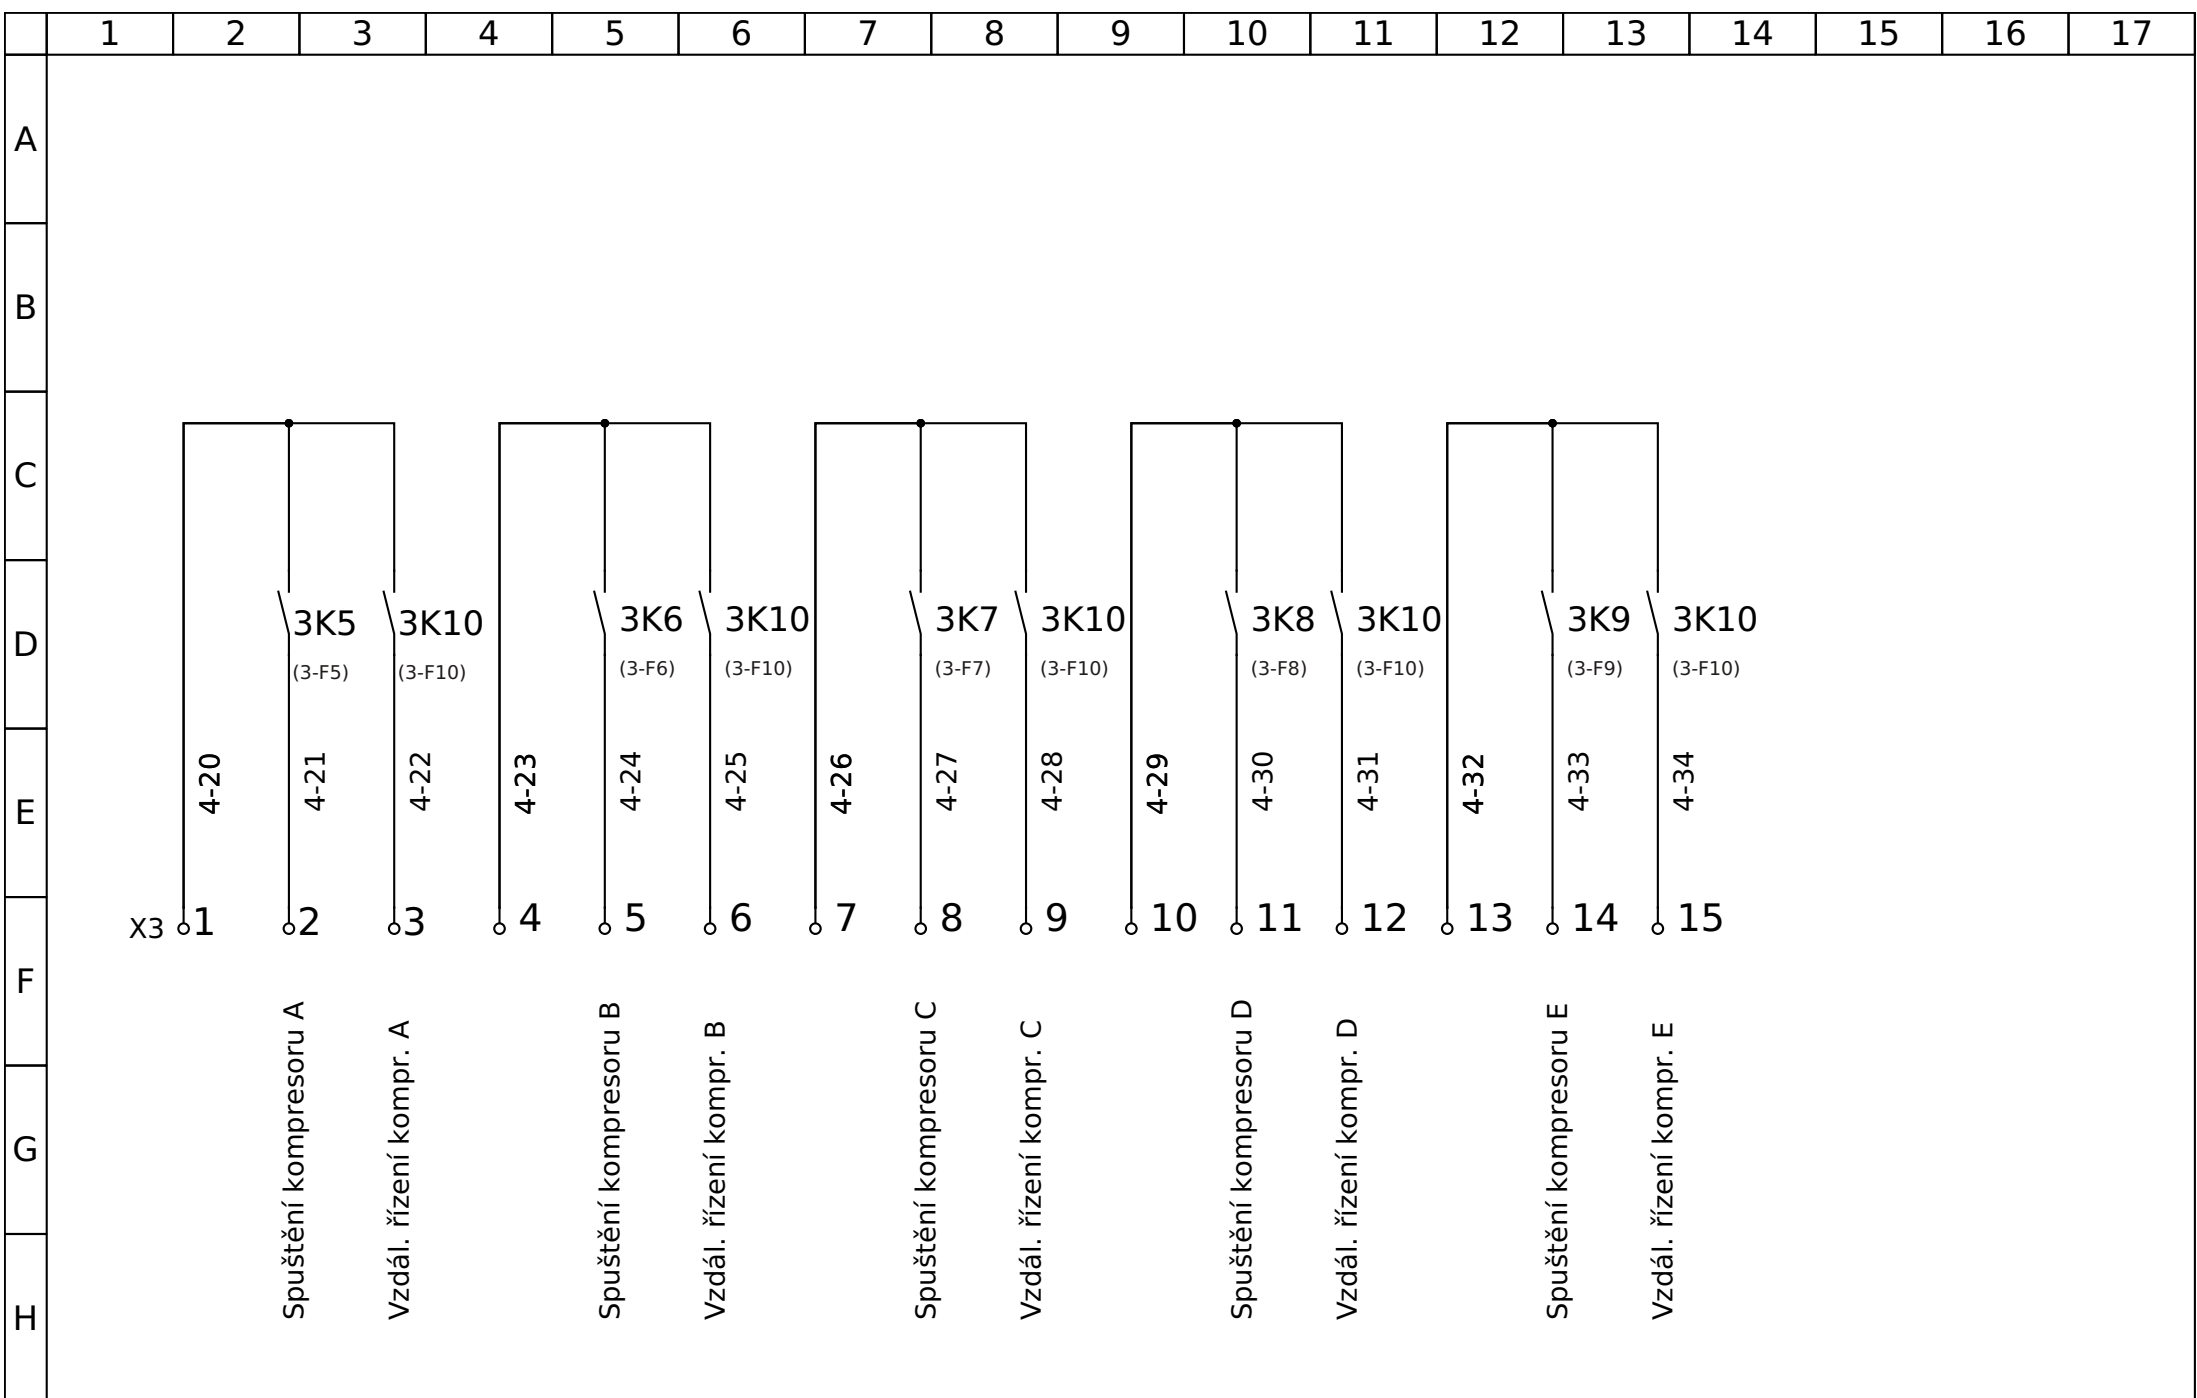

PROV	230V	NAVRH	KRIVANKA	13.7.2015
REV	2	KONTROLA	KRIVANKA	18.7.2015
ZMĚNA	04.06.18	SCHVALENÍ	KRIVANKA	23.7.2015



Digital outputs